



सीएसआईआर – के० ख० एवं ई० अ० सं० परीक्षण प्रकोष्ठ

CSIR - CIMFR TESTING CELL




TEST CERTIFICATE / परीक्षण प्रमाण पत्र

अतिरिक्त प्रथम प्रति  
Additional First Copy

ID Number: 250/16 Code Number: FLP/65/16  
 Test Date : 01/09/2016  
 Manufacturer Details : M/S KESKAMAT & COMPANY  
 Manufacturer Address : MUMBAI- 400 025  
 Model / Type : MODEL NO .: JB2016-IIC  
 Category No. : NA  
 Gas : HYDROGEN  
 Gas Group : IIC  
 Equipment Details : FLP/WP JUNCTION BOX  
 Enclosure Details : SINGLE ENCLOSURE  
 Serial / Badge No. : NA  
 Peak Pressure : 4.53 Bar at 23.46 ms

Explosion Pressure vs Time Graph

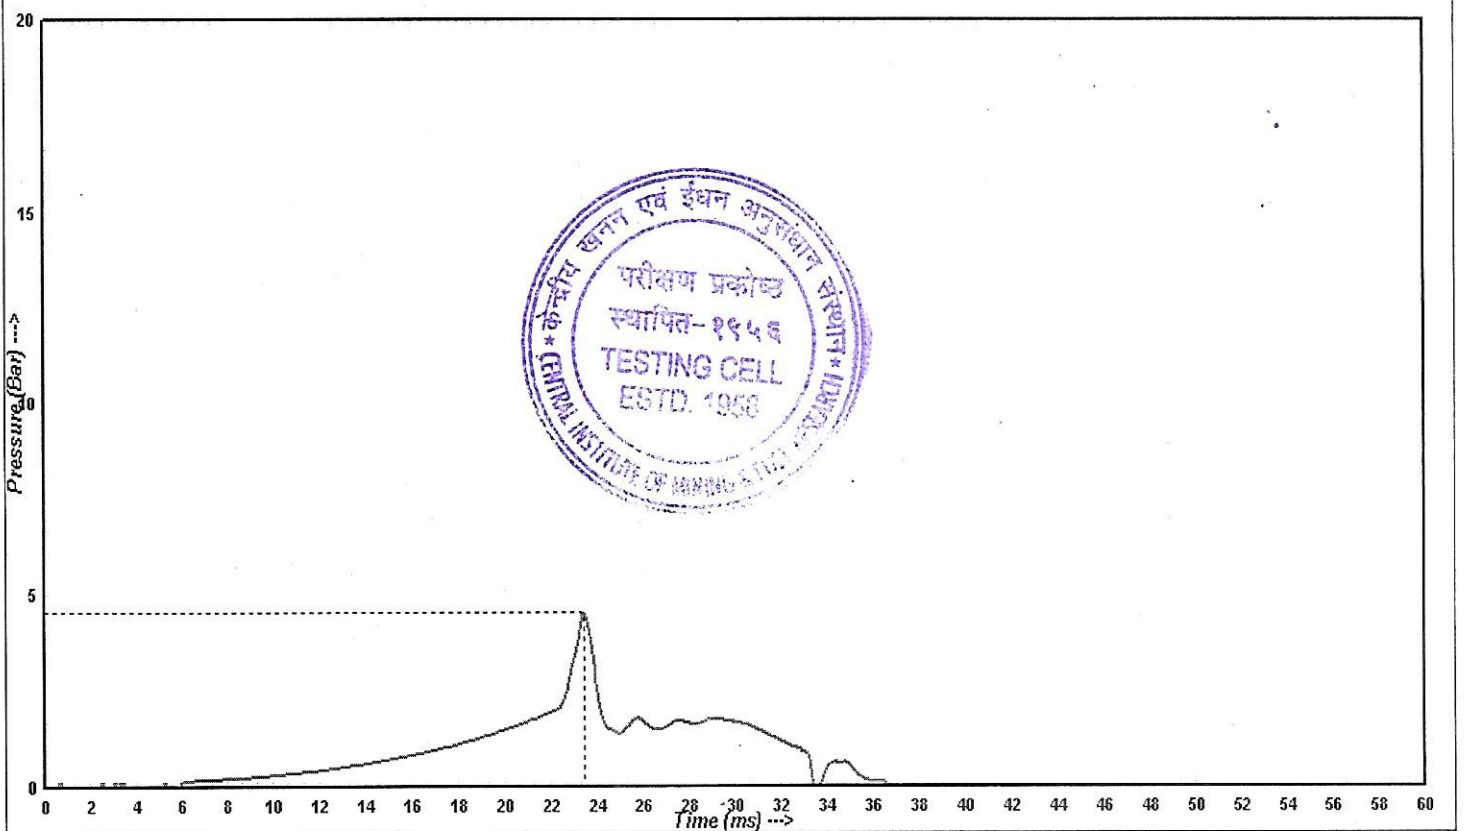

*Remishoa*  
8.9.16.  
(Testing Officer)

*[Signature]*  
(Discipline Head)