



सीएसआईआर - के० ख० एवं ई० अ० सं० परीक्षण प्रकोष्ठ


CSIR - CIMFR TESTING CELL



TEST CERTIFICATE / परीक्षण प्रमाण पत्र ORIGINAL COPY

ID Number: 51/16 Code Number: FLP/201/15  
 Test Date : 05/05/2016  
 Manufacturer Details : M/S KESHKAMAT & CO.  
 Manufacturer Address : MUMBAI - 400 025  
 Model / Type : TYPE NO. : KK / FWGLF / 01  
 Category No. : CAT NO. : KK / WGLF / 07 / 201  
 Gas : ETHYLENE  
 Gas Group : IIB  
 Equipment Details : FLP/WP WELL GLASS LIGHTING FITTING  
 Enclosure Details : SINGLE GLASS ENCLOSURE  
 Serial / Badge No. : NA  
 Peak Pressure : 3.67 Bar at 6.6 ms

Explosion Pressure vs Time Graph

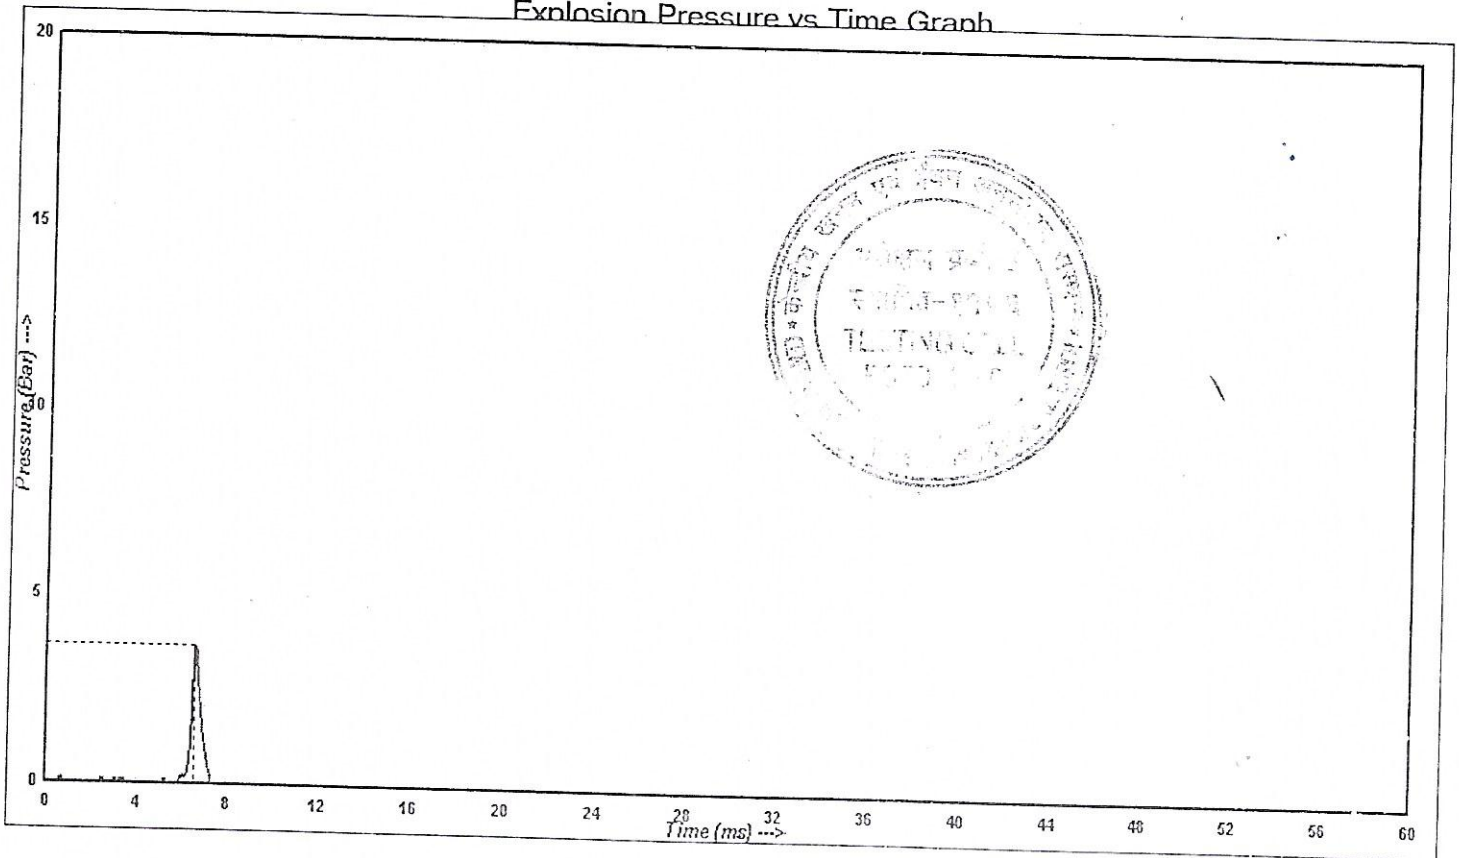

*Q. Deel*  
 (Testing Officer) 20/05/16

*Deel*  
 (Discipline Head) 20/05/16