



सीएसआईआर - के० ख० एवं ई० अ० सं० परीक्षण प्रकोष्ठ

CSIR - CIMFR TESTING CELL


TEST CERTIFICATE / परीक्षण प्रमाण पत्र

Continuation Sheet

ORIGINAL COPY

ID Number: 52/16 Code Number: FLP/201A/1
Test Date: 05 / 05 / 2016
Manufacturer Details: M/S KESHKAMAT & CO.
Manufacturer Address: MUMBAI - 400 025
Model / Type: TYPE NO. : KK / FWGLF / 02
Category No.: CAT NO. : KK / WGLF / 07 / 03
Gas: ETHYLENE
Gas Group: IIB
Equipment Details: FLP/WP WELL GLASS LIGHTING FITTING
Enclosure Details: SINGLE GLASS ENCLOSURE
Serial / Badge No.: NA
Peak Pressure: 3.83 Bar at 7.98 ms

Explosion Pressure vs Time Graph

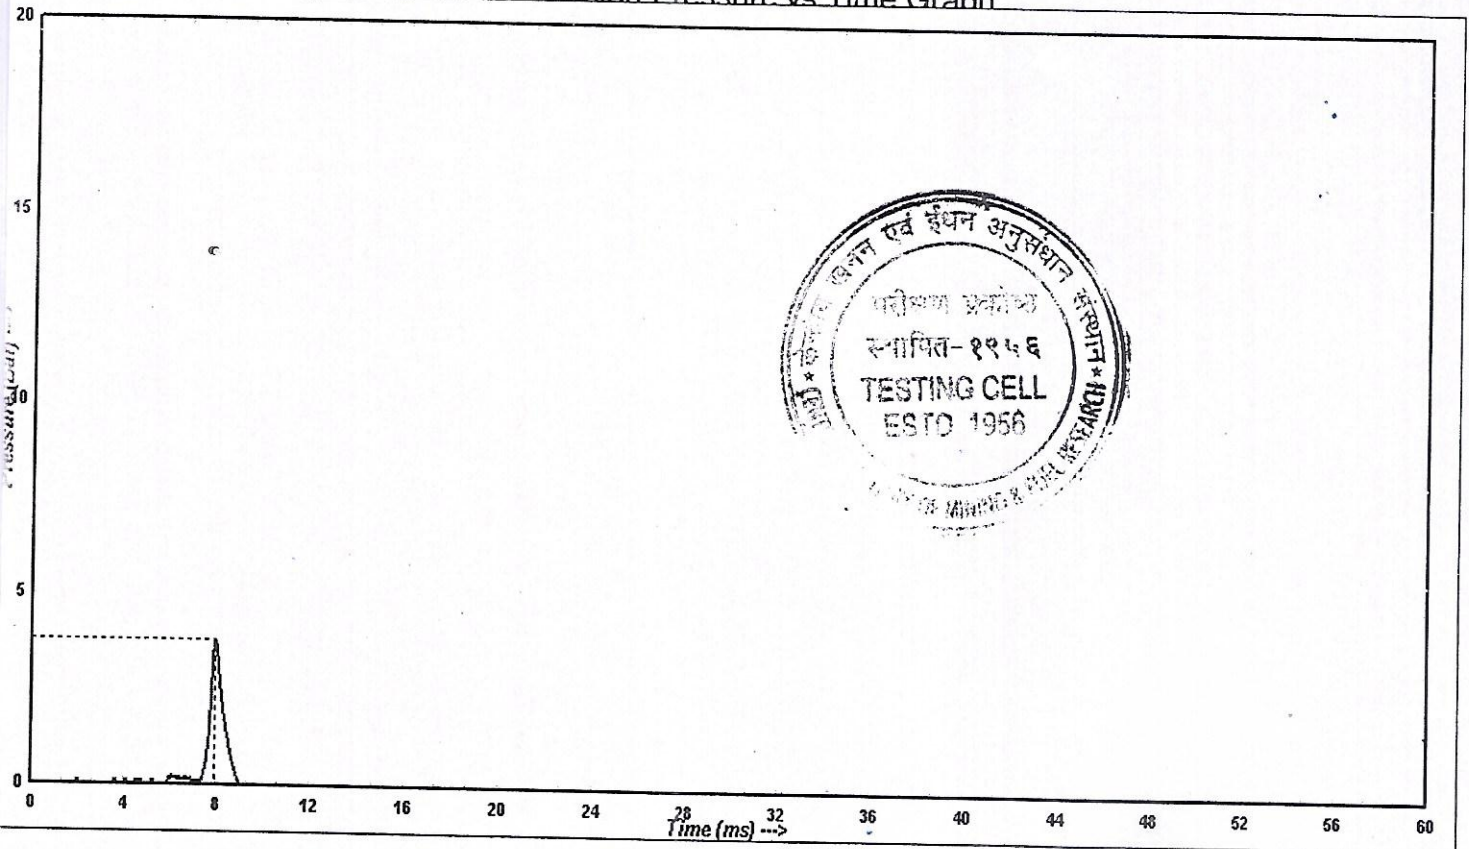

Ricmishoa
8.8.16.
(Testing Officer)

(Discipline Head)
08/08/16